


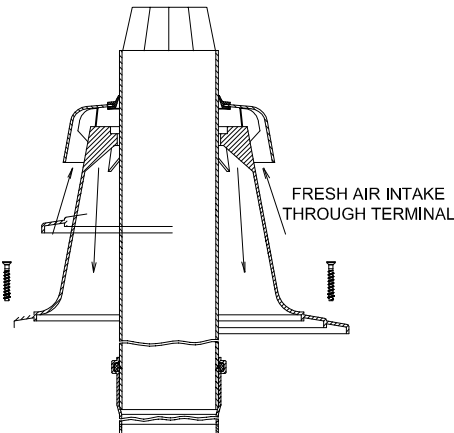


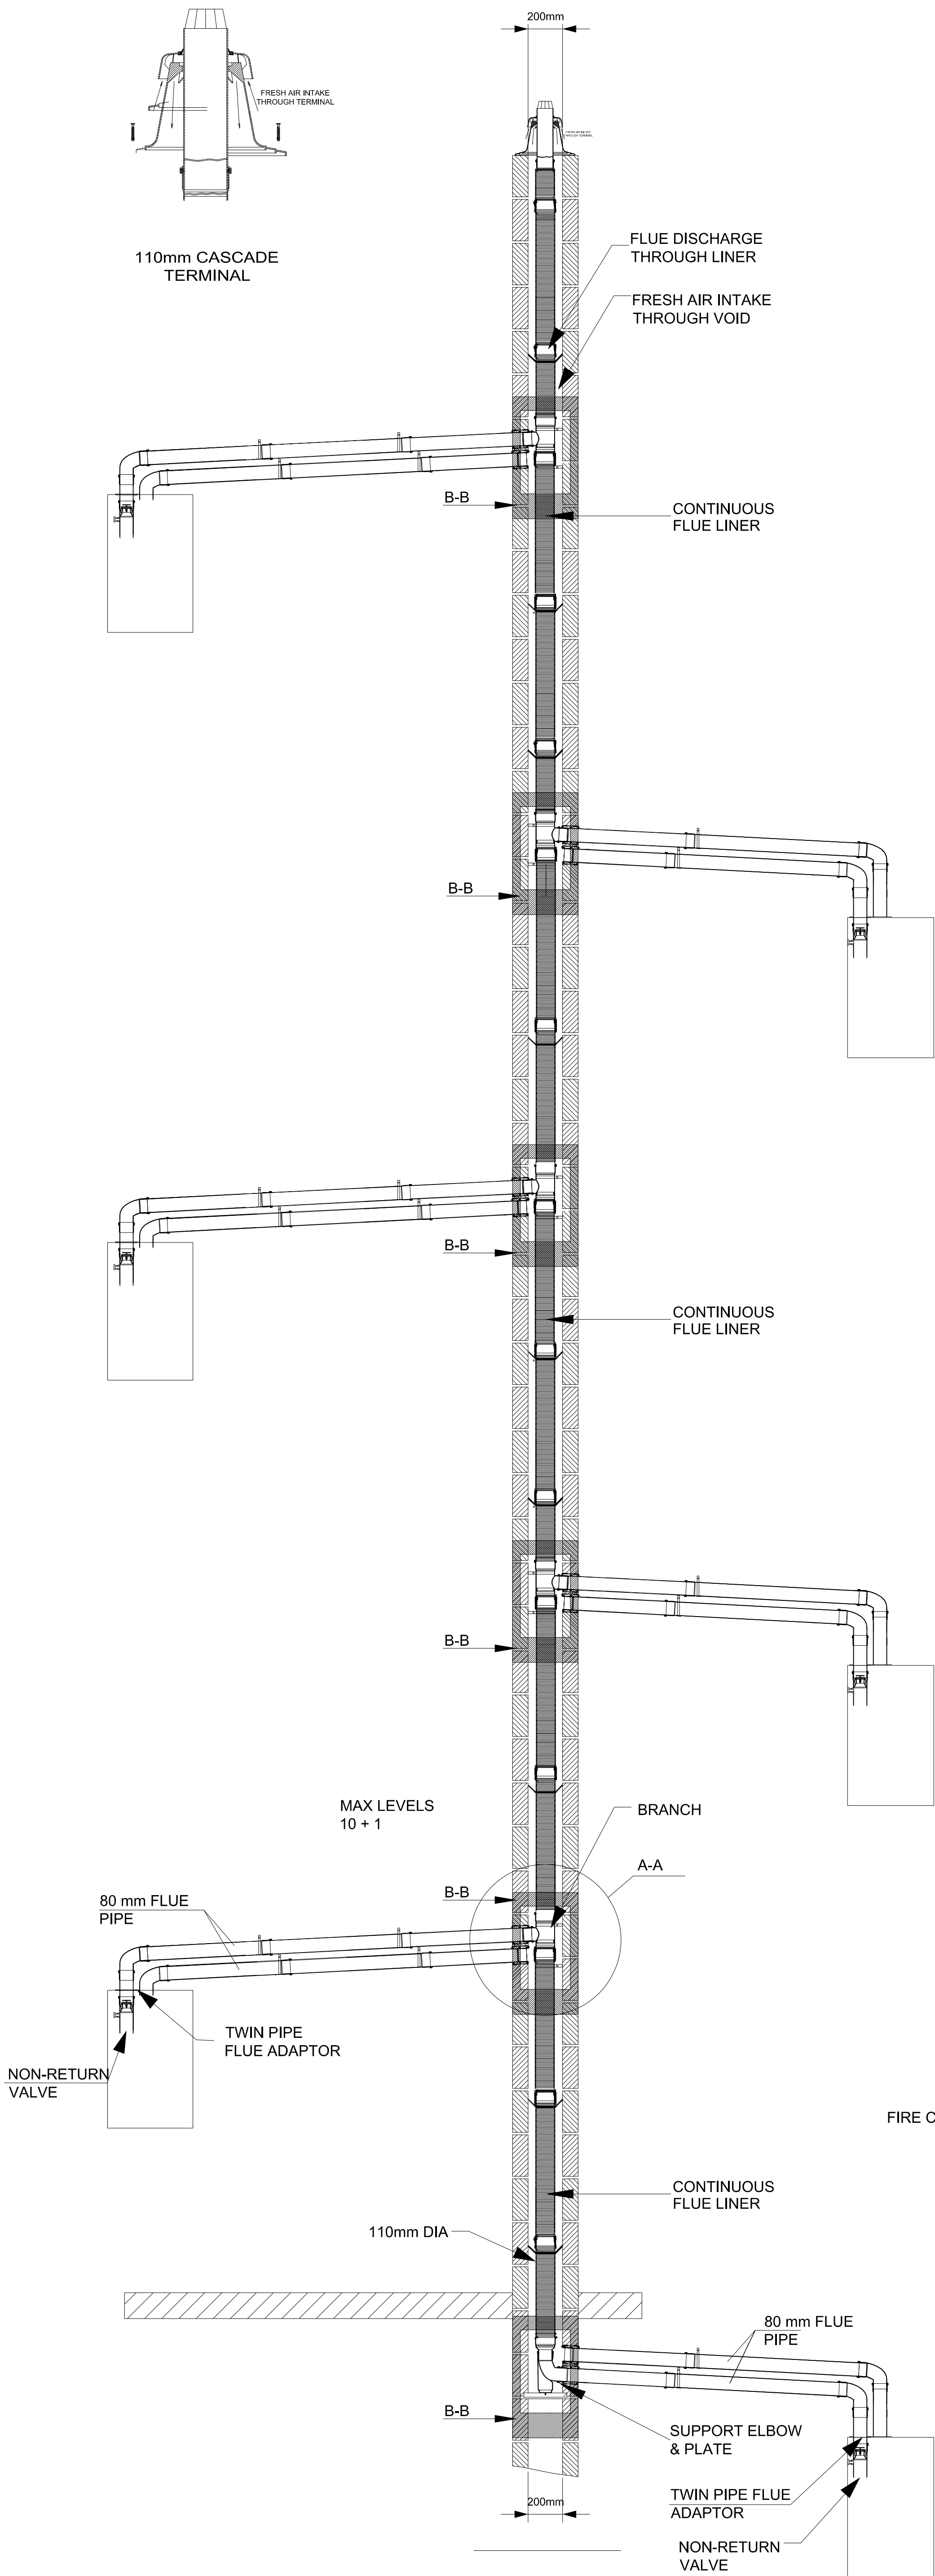

110mm CASCADE
TERMINAL

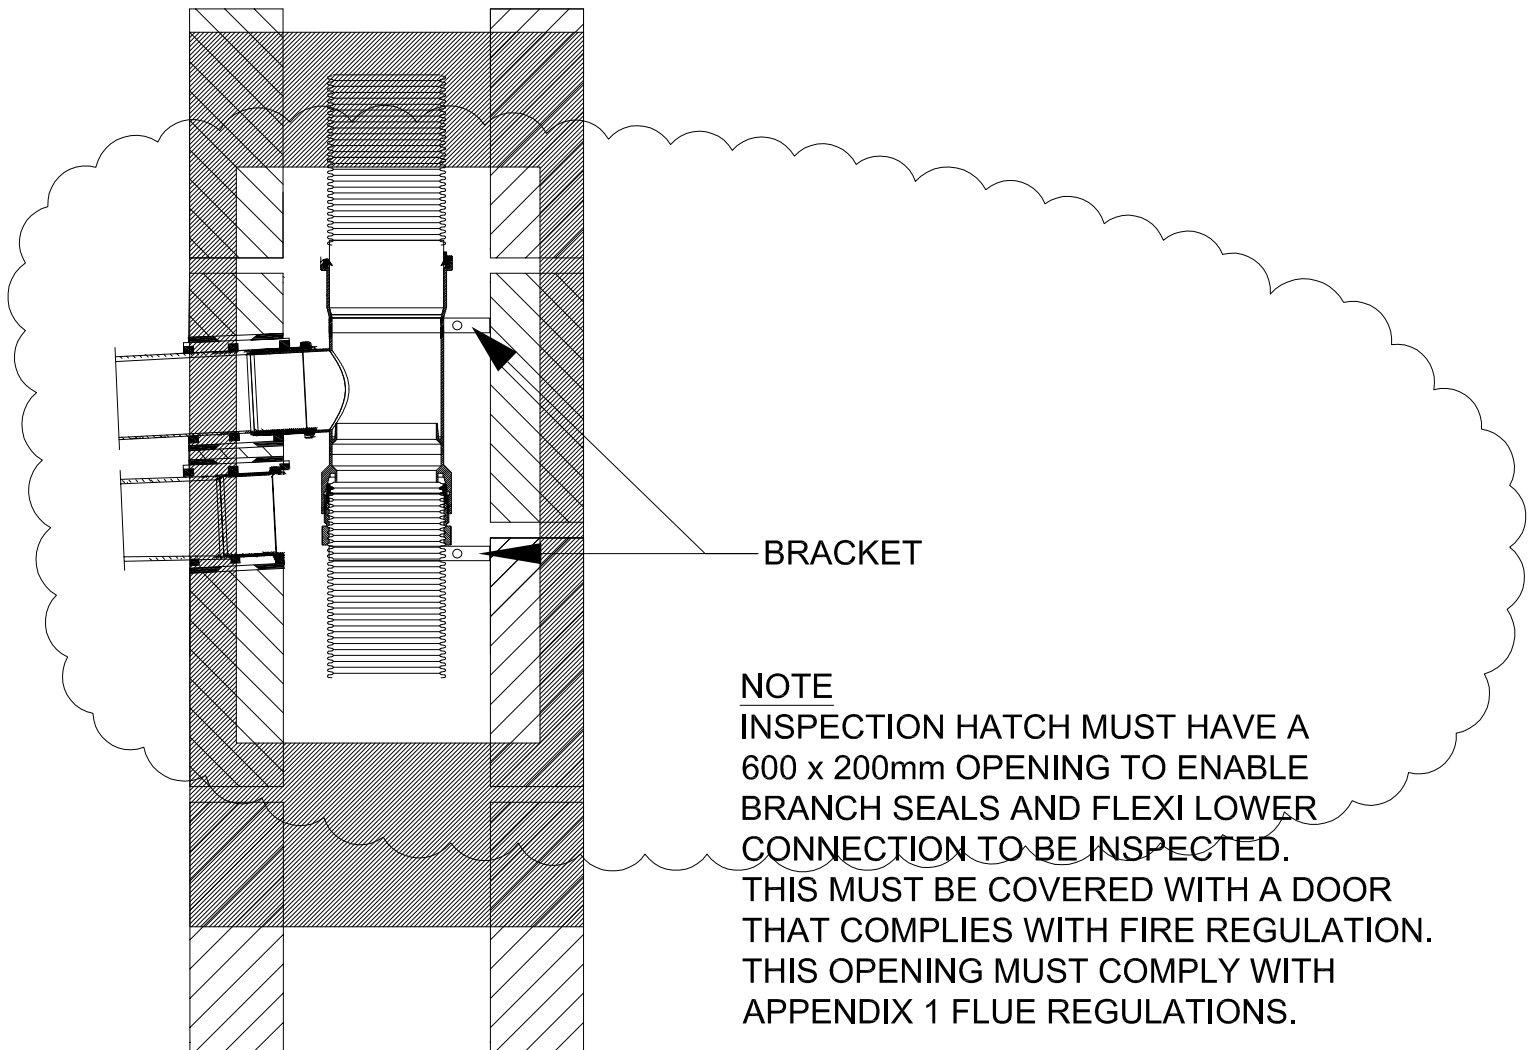

DETAIL "B" - "B"

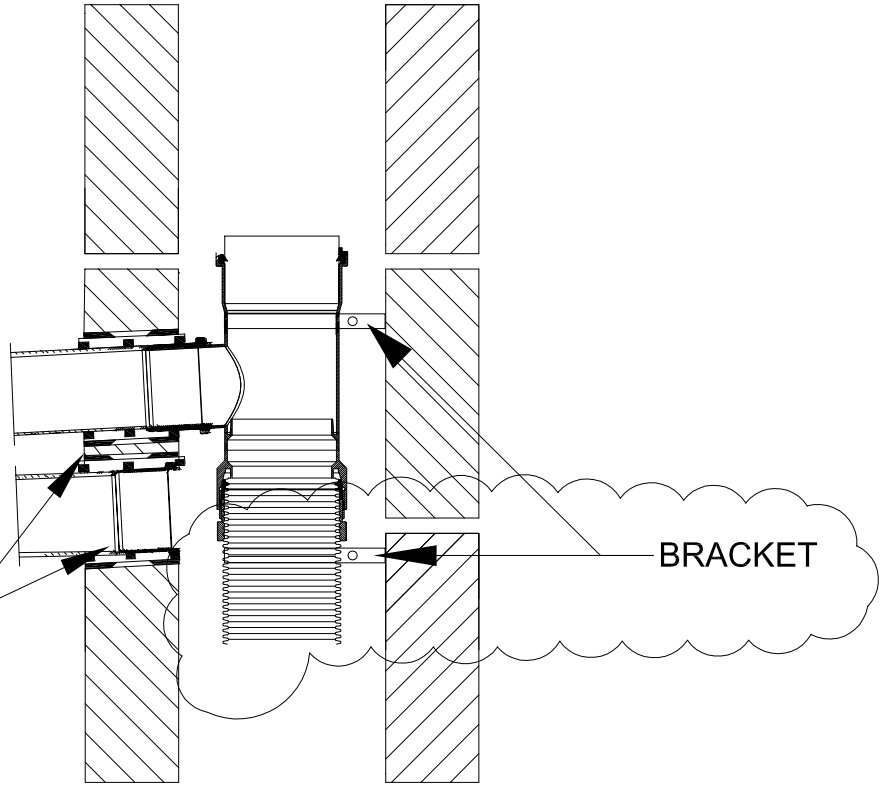

DETAIL "A" - "A"

NOTE
INSPECTION HATCH MUST HAVE A
600 x 200mm OPENING TO ENABLE
BRANCH SEALS AND FLEXI LOWER
CONNECTION TO BE INSPECTED.
THIS MUST BE COVERED WITH A DOOR
THAT COMPLIES WITH FIRE REGULATION.
THIS OPENING MUST COMPLY WITH
APPENDIX 1 FLUE REGULATIONS.

A	9/3/18	SECTIONS A-A & B-B UPDATED
REV	DATE	REVISION

GEMTEX
HEATING SOLUTIONS LTD

65 Basepoint Business Centre
Aviation Business park
Enterprise Close, Christchurch, BH23 6NX
Tel: 01256 587 800, Email: info@gemtex.co.uk, Web: www.gemtex.co.uk

CLIENT			
PROJECT			
TITLE TYPICAL CASCADE FLUE SYSTEM			
DRAWN BJW	CHECKED DW	DATE SEPT.2017	SCALE N.T.S.
DRAWING No GT / CAS - 01			A
DRAWING STATUS			